


CITY: SYRACUSE, NY DIV: GROUP: ENV/IM/DV DB: P. LISTER, PM: J. HOLDEN, TMTR: R. STEVENSON LVR: ONL-OFF-REF (FRZ)
 G:\ENV\CAD\SYRACUSE\ACT\18064634\000\022000\DWG\54634C02.DWG LAYOUT: 7. SAVERD: 9/10/2012 3:14 PM. ACADVER: 18.1S (LMS TECH) PAGES: 18. PLOT: PLT54634C02.PLT PLOTTED: 9/10/2012 3:15 PM BY: LISTER, PAUL
 XREFS: IMAGES: PROJECTNAME: 54634X01

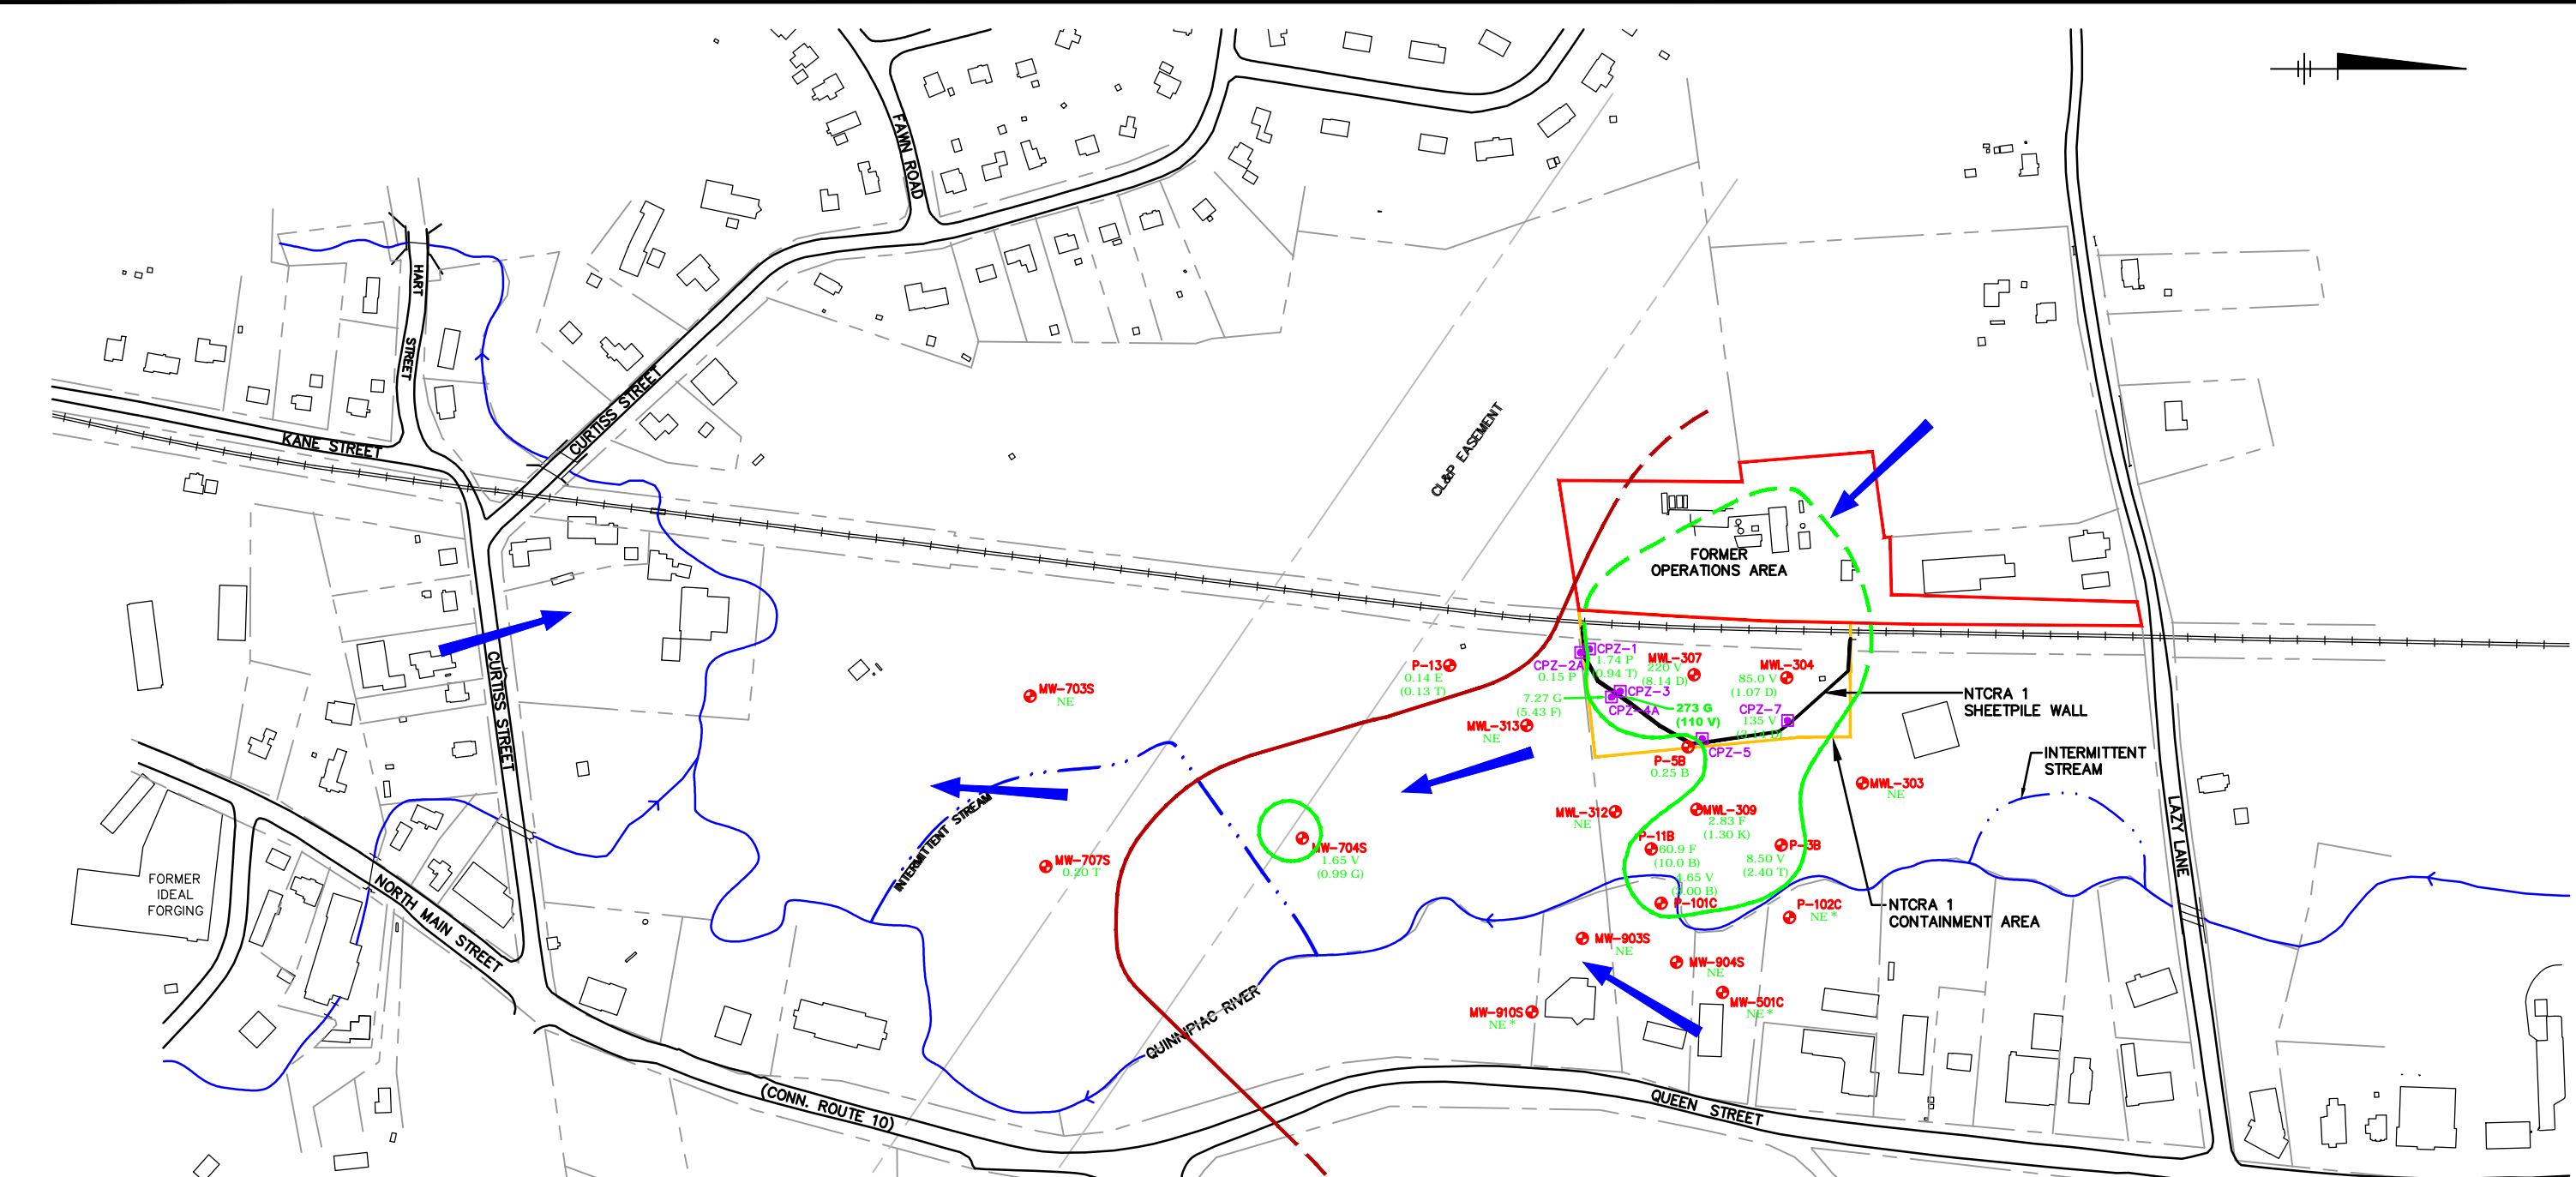


NOTE:
 1. MAPPING BASED ON FIGURE "SOLVENT RECOVERY SERVICE OF NEW ENGLAND REMEDIAL INVESTIGATION/FEASIBILITY STUDY, LAZY LANE, SOUTHTON, CONN." DATED 6-28-93 BY DIVERSIFIED TECHNOLOGIES CORPORATION.

- KEY:**
- B BENZENE
 - D CIS-1,2-DICHLOROETHENE
 - F TETRAHYDROFURAN
 - G CHLOROETHANE
 - P TETRACHLOROETHENE
 - T TRICHLOROETHENE
 - V VINYL CHLORIDE
 - E 1,1-DICHLOROETHENE
 - K 1,2-DICHLOROETHANE
 - NE EXCEEDANCE RATIO LESS THAN 0.10

- LEGEND:**
- SHALLOW OVERBURDEN MONITORING WELL
 - PIEZOMETER
 - ESTIMATED EXTENT OF GROUNDWATER VOC EXCEEDANCES OF MCLs OR CT DEEP CLASS GA GWPCs (2010-2012 SAMPLING RESULTS)(DASHED WHERE INFERRED)
 - ESTIMATED NTCRA 2 CAPTURE ZONE BOUNDARY
 - ← GENERALIZED GROUNDWATER FLOW DIRECTION
- MWL-309**
 2.83 F
 (1.30 K)
 WELL WITH REGULATORY EXCEEDANCE RATIO. NUMBERS >1.0 INDICATE GROUNDWATER REGULATORY LIMIT EXCEEDED. NUMBERS <1.0 INDICATE EXCEEDANCE RATIO FOR COMPOUNDS DETECTED BELOW REGULATORY LIMIT. FIRST NUMBER INDICATES MAXIMUM MULTIPLE OF A DETECTED VOC OVER REGULATORY LIMIT (e.g., 130 INDICATES 130 x LIMIT). LETTER INDICATES COMPOUND WITH INDICATED EXCEEDANCE RATIO (e.g., P = TETRACHLOROETHENE). NUMBERS IN PARENTHESES INDICATE OTHER EXCEEDANCE RATIOS FOR SELECT COMPOUNDS AND WELLS. COMPOUNDS DETECTED IN BLANK(S) ARE NOT INCLUDED IN THIS EVALUATION.
- * NO DETECTIONS ABOVE INTERIM CLEANUP LEVELS (ICLs) AT THIS LOCATION.

DRAFT



SRNE SUPERFUND SITE
 SOUTHTON, CONNECTICUT
MONITORED NATURAL ATTENUATION REPORT

**VOC EXCEEDANCE PLUME
 SHALLOW OVERBURDEN**

ARCADIS

FIGURE
7